APPLICATION

The 40003916 is a replacement powerhead for the V4043, V4044, V8043, V8044 fan coil and zone valves. See Table 1 on page 2. The powerhead includes the motor, housing and 2 mounting screws. Models are available for low or line voltage applications.

This powerhead is for use with new style valve bodies (series 6) or old style valve bodies (series 1-5) that have been converted to accept this powerhead. The new style valve bodies are identified with a sideways 6 on the powerhead after the OS number and an indent under the OS number on the powerhead. See Fig. 1. If using an old style valve, the valve must be converted using Part No. 40003918 (order separately).

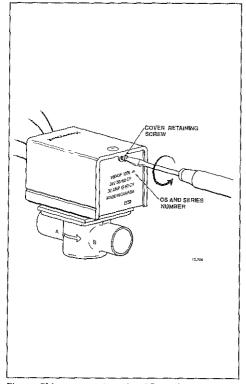


Fig. 1—Sideways number after OS number on powerhead identifies valve series.

INSTALLATION .

WHEN INSTALLING THIS PRODUCT...

- Read these instructions carefully. Failure to follow them could damage the product or cause a hazardous condition.
- Check the ratings given in the instructions and on the product to make sure the product is suitable for your application.
- Installer must be a trained, experienced service technician.
- After installation is complete, check out product operation as provided in these instructions.

CAUTION

Disconnect power supply before connecting wiring to prevent electrical shock or equipment damage.

SYSTEMS WITH OLD STYLE VALVE BODIES (SERIES 1-5)

To install this powerhead in a system with an old style valve body (series 1-5), the valve body must be converted to accept 40003916 Powerhead using Part No. 40003918 Conversion Kit. The kit includes a metal plate with driveshaft and rubber plug, O-ring, and 4 screws.

- IMPORTANT -

Converting the valve body for use with the new powerhead does not require removal of the valve body from the pipeline. It is, however, necessary to drain the water from the system before beginning the conversion.

- 1. Disconnect power supply before connecting wiring to prevent electrical shock or equipment damage.
- Disconnect the leadwires to the powerhead at terminal block or conduit connection. Remove conduit or cable connector if fitted. Label each wire for rewiring later.
 - 3. Drain the water from the system.
- 4. Remove the old powerhead from the valve body (see Fig. 2)—
 - —Place the manual opening lever (normally closed models only) on the old powerhead in the MAN. OPEN position (Fig. 2A).
 - -Remove the cover (Fig. 2B).
 - —With the cover off, remove the 4 screws securing the powerhead to the valve body.
 - -Lift the powerhead off the valve body (Fig. 2C).
 - -Remove the O-ring from the top of the valve body.

continued on next page

TABLE 1-POWERHEAD REPLACEMENTS.

| VALVE MODEL NUMBER | REPLACEMENT POWER- HEAD PART NUMBER | | VOLTAGE (Vac) AND FREQUENCY | CURRENT DRAW (A) | TYPE OF ELECTRICAL | COMMENTS |
|--------------------------|--|-----------------------|--------------------------------|---------------------|------------------------------|----------|
| | | | | | | |
| | | CONNECTION ON MAN. | CONNECTION | | | |
| | OPENER END | OPPOSITE | | | | |
| | OPENER END | MANUAL OPENER | | | | |
| V4043A | 40003916-024 | | 120, 60 | 0.08 | 18 in. [457 mm] | Class F |
| | 40003916-022 | | 220/50, 240/60 | 0.04 | leads (conduit | Class F |
| | 40003916-023 | | 240, 50 | 0.04 | opening) | |
| V4043B | 40003916-031 | | 120, 60 | 0.08 | obelling) | 01 |
| | 40003916-029 | | 208, 60 | 0.04 | 4 | Class F, |
| | 40003916-030 | | 220/50, 240/60 | 0.04 | 4 | plated |
| | 40003916-028 | | 208, 60 | 0.04 | - | |
| V4043E | 40003916-041 | | 120, 60 | 0.04 | - | |
| | 40003916-042 | | 208, 60 | 0.08 | | Class F |
| V8043A | 40003916-021 | | 24, 50/60 | 0.32 | 1 | |
| V8043B | 40003916-027 | _ | 24, 50/60 | 0.32 | 1 | Class A |
| V8043E | 40003916-026 | _ | 24, 50/60 | 0.32 | - | Class A |
| V8043F | 40003916-048 | | 24, 50/60 | 0.32 | Terminal Block | Class A |
| V8043J | . — | | 24, 50/60 | 0.32 | | Class A |
| (Steam) | | | - 1, 55, 55 | 0.02 | 18 in. [457 mm] | |
| | | İ | | | leads (conduit | |
| V4044A | 40003916-047 | 40003916-036 | 120, 60 | 0.08 | opening) 96 in. [2438 mm] | |
| | | | .20,00 | 0.00 | | Class F, |
| | | | | | leads (conduit | plated |
| | | 40003916-020 | 120, 60 | 0.08 | opening) | |
| | | 40003916-033 | 208, 60 | 0.04 | 72 in. [1829 mm] | |
| | | | 200, 50 | 0.04 | 18 in. [457 mm] | |
| | | | | | leads (conduit | |
| | | | | | opening) | |
| | | 40003916-035 | 220/50, 240/60 | 0,04 | | |
| | | 40003916-034 | 240, 50 | 0.04 | | |
| V4044B | 40003916-045 | 40003916-040 | 120, 60 | 0.08 | 18 in. [457 mm] | - OI - F |
| | | 40003916-039 | 220/50, 240/60 | 0.04 | leads (conduit | Class F, |
| | | 40003916-038 | 240, 50 | 0.04 | opening) | plated |
| V4044C | | 40003916-049 | 120, 60 | 0.08 | 72 in. [1829 mm] | Class F, |
| | | | | | | plated |
| V8044A | 40003916-046 | 40003916-032 | 24, 50/60 | 0.32 | 18 in. [457 mm] | Class A. |
| 1/20/17 | | | | · 1 | leads (conduit | plated |
| V8044B | 40003916-044 | 40003916-037 | 24, 50/60 | 0.32 | opening) | hiaran |
| V8044E | 40003916-025 | 40003916-043 | 24, 50/60 | 0.32 | oponing) | |

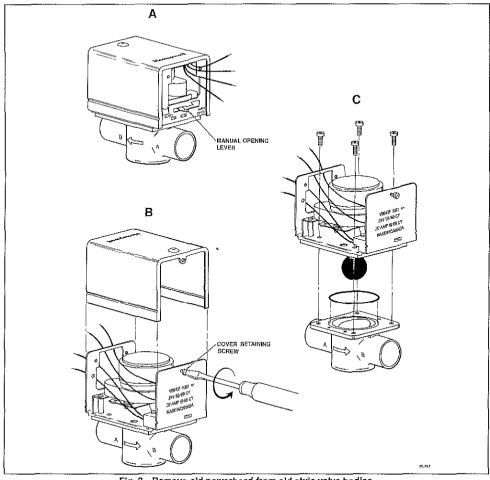


Fig. 2-Remove old powerhead from old style valve bodies.

- 5. Install 40003918 Conversion Kit (see Fig. 3)-
 - -Insert new O-ring in the valve body.
 - -Place metal plate with rubber plug on top of valve body. Make sure the guide pins on the underside of metal plate fit into recesses on valve body.
 - -Secure the metal plate to the valve body with the 4 screws (2 sets) provided. One set of screws has heads with recessed threads to insert screws for mounting powerhead; insert this set in the larger screw openings. The other set has domed heads; insert this set in the smaller screw openings. Each set must be inserted in the opposite corners of the metal plate so screws sit flat on the plate. Make sure the guide pins on the plate fit into recesses on valve body.




Fig. 3-Install 40003918 Conversion Kit,

3 69-0404

- 6. Install new powerhead (Fig. 4)-
 - —Place the manual opening lever (normally closed models only) on the new powerhead in the MAN. OPEN position.
 - —Fit the powerhead onto the valve body, ensuring that the shaft seats correctly. The powerhead




Fig. 4-Install new powerhead.

- should be aligned so that the manual opening lever or slot for lever is at the port A end of the valve body.
- Secure the powerhead to the valve body with the 2 screws provided.
- —If fitted, reconnect the conduit or cable. Reconnect the leadwires.
- Roplace powerhead cover.
- 7. Turn on power.

SYSTEMS WITH NEW STYLE VALVE BODIES (SERIES 6)

- IMPORTANT -

On a new style valve body or a valve body that has been converted to accept this new powerhead, it is not necessary to drain the system if the valve body remains in the pipeline.

- Disconnect power supply before connecting wiring to prevent electrical shock or equipment damage,
- Disconnect leadwires to powerhead at terminal block or conduit connection. Disconnect conduit or cable connector if fitted. Label each wire for rewiring later.
 - Remove old powerhead (see Fig. 5)—
 - —Place the manual opening lever (normally closed models only) on the old powerhead in the MAN. OPEN position (Fig. 5A).
 - Remove screw securing the cover to the power-head. Lift powerhead cover off (Fig. 5B).
 - —Remove the 2 screws securing the powerhead to the valve body (Fig. 4).
 - -Lift powerhead off the valve body.

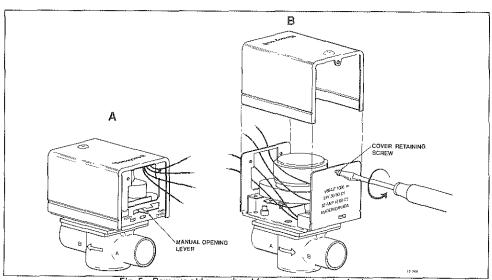


Fig. 5—Remove old powerhead from new style valve body.

- 4. Install the new powerhead (see Fig. 4)-
 - —Place the manual opening lever (normally closed models only) on the new powerhead in the MAN. OPEN position.
 - —Fit the powerhead onto the valve body, ensuring that the shaft seats correctly. The powerhead should be aligned so that the manual opening lever
- or slot for lever is at the port A end of the valve body.
- Secure the powerhead to the valve body with the 2 screws provided.
- —If fitted, reconnect the conduit or cable. Reconnect the leadwires to the powerhead.
- -Replace powerhead cover.
- 5. Turn on power.

OPERATION AND CHECKOUT

(S) I E (O)/

On 24 V systems, never jumper the valve coil terminals even temporarily. This may burn out the heat anticipator in the thermostat.

OPERATION

NORMALLY CLOSED MODELS


With the manual opening lever set to AUTO and the powerhead energized, the valve is opened as shown in Fig. 6A. When the powerhead is de-energized, a spring-return mechanism drives the valve to the closed position as shown in Fig. 6B. The valve can also be opened with no electrical power by moving the manual opening lever over the stop and pushing slowly and firmly to the MAN. OPEN position. The stop permits the valve to be locked in the open position. The valve will return to automatic position when the valve is energized.

Auxiliary switch is not energized when valve is manually opened.

NORMALLY OPEN MODELS

When the powerhead is de-energized, a spring-return mechanism drives the valve to the open position (Fig. 6A). When energized, the valve is closed a shown in Fig. 6B. A reverse-acting thermostat is required to control a normally open valve.

NOTE: Inlet Port is stamped "A," Outlet Port is stamped "B" on the valve body.



Flg. 6---Valve.

CHECKOUT

- Raise the set point on the zone thermostat above room temperature to initiate a call for heat.
- 2. Observe all control devices—the valve should open and the auxiliary switch should make the circuit to the circulator or other valve at the end of the opening stroke.
- Lower the set point on the zone thermostat below room temperature.
- 4. Observe the control devices. The valve should close and auxiliary equipment should stop.

SERVICE

This valve should be serviced by a trained, experienced service technician.

- If the valve is leaking, drain the system and check to see if the O-ring needs to be replaced.
- If the gear train is damaged, replace the entire powerhead assembly. See INSTALLATION. If motor is burned out, replace motor. See Replacement Parts list in TRADE-LINE Catalog.

NOTE: Honeywell zone valves are designed and tested for silent operation in properly designed and installed systems. However, water noises may occur as a result of excessive water velocity. Piping noises may occur in high temperature (over 212° F [100° C]) systems with insufficient water pressure.

